
Monitoring Technique

VARIMETER Motor Load Monitor BH 9097





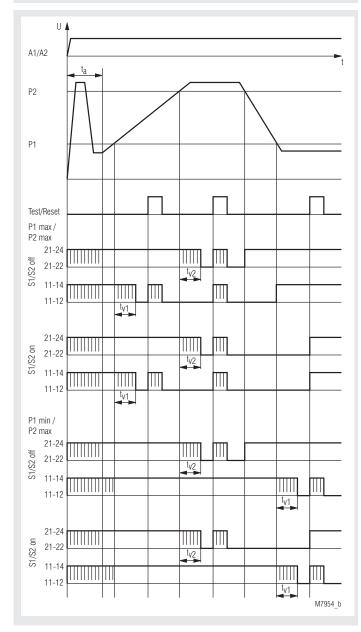

P1max/P2max:
 Overload monitoring with prewarning

 P1min/P2max:
 Under- and overload monitoring

 S1/S2 ON:
 manual reset

 S1/S2 OFF:
 automatic reset

 IIIII:
 corresponding LED is flashing

 *) when set to energized on fault the function of LEDs and output relays are inverted.

Function Diagram for Setting De-energized on Fault*)

- According to IEC/EN 60255-1, IEC/EN 60255-26, DIN/VDE 0435-303
- Identification of - Underload P_1 and Overload P_2
- Overload P_1 (prewarning) and Overload P_2 programmable
- Adjustment of P_1 and P_2 on absolute scale
- For motors up to 22 kW / 400 V; 37 kW / 600 V
- Measurement: effective power
- Large current range because of automatic range selection
- 1 changeover contact for P1 and 1 changeover contact for P2
- Adjustable start-up delay ta
- Adjustable switching delay t_v
- With automatic or manual reset, programmable
- Test / Reset button for easy setup
- Up to 40 A without external current transformer
- De-energized or energized on fault, programmable
- Also for single-phase operation
- LED indicators
- Width 45 mm

Approvals and Marking



* see variants

Applications

The BH 9097 is used to monitor variable loads on industrial motors.

Function

The motor load monitor BH 9097 checks the active power consumption of electrical consumers. As the measuring principle is only single phase correct measurement of 3-phase load is only possible when all three phases have the same load which is normal with motors. Using DIP-switches the unit can be set up to act as under- and overload relay P_{1min}/P_{2max} or as overload relay with pre-warning P_{1max}/P_{2max} . The settings of P_1 and P_2 are absolute values and calibrated in Watts adjustable via rotational switches. 2 LEDs show the state of the corresponding output relays. The unit can be configured to energise or to de-energise on fault. Every output relay is fitted with it's own time delay t_v . A start-up delay t_a acts on both outputs.

Indication

green LED, $U_{\rm N}$:	flashing: continuous:	during Start-up delay t _a supply connected
yellow LED, P_1 :	flashing:	during time delay t_{v1} and for set up assistance
yellow LED, P ₂ :	continuous: flashing:	when relay P_1 active (contact 11-14) during time delay t_{v_2} and for set up assistance
	continuous:	when relay P_2 active (contact 21-24)

Fault indication

1

2 different faults are displayed with the LEDs.


1.) No measurement:

Without measuring voltage measurement is not possible - All 3 LEDs flash in sequence one after the other. The output contacts are in failure state.


2.) The BH 9097 measures negative load:

- Possible reason: The unit measures reverse power or the current connections are connected wrong.
- All 3 LEDs flash simultaneously.


Connection Diagrams




BH 9097.38/001



BH 9097.38/011



BH 9097.38



BH 9097.38/010

Technical Data

Input

Measuring voltage Voltage range:

Input resistance: **Measuring current** Measuring range:

without auxiliary voltage 0.8 ... 1.1 x U_N with auxiliary voltage, see setting ranges 300 kΩ ... 500 kΩ

see setting ranges

Nominal current [A]	40	24	8	2.4	0.8	0.24
Permissible current range						
(overload) [A]	0 40		0 10	~ ~		• •
continuously:	040	0 40	016	08	0 2,4	01
1 min. (10 min. break):	150	150	20	16	3	1,5
20 s (10 min. break):	200	200	25	20	4	2
Input res. of current on i-k [m Ω]:	≤ 1	≤1	7	14	830	830

Frequency range:

10 ... 400 Hz (please see characteristics M7953)

Setting Ranges

P1 und P2 on absolute scale Switch

load range for P1 and P2:

Measuring accuracy (in % of setting value): Hysteresis (in % of setting value): Harmonic distortion **Reaction time:** Switching delay t_{v1}/t_{v2} : Start-up delay t_a :

lower range upper range ± 4 % (2 % on request)

< 5 % < 40 % < 50 ms 0 ... 10 s (infinite variable) 0 ... 30 s (infinite variable)

Setting Ranges

Available variants	Measuring voltage U _N	Measuring current I _N [A]	selection of load range
1-phase	14 a a a		
without auxiliary vol	tage		
BH 9097.38/000	AC 230 V	0.0024 0.24	0.1 60 W
	AC 230 V	0.024 2.4	1 600 W
	AC 230 V	0.24 24	10 6000 W
with auxiliary voltag	e		
BH 9097.38/010	AC 35250 V	0.0024 0,24	0.1 60 W
	AC 35250 V	0.024 2,4	1 600 W
	AC 35250 V	0.24 24	10 6000 W
3-phase			
without auxiliary vol	tage		
BH 9097.38/001	3 AC 400 V	0.008 0,8	0.1 60 W
	3 AC 400 V	0.08 8	10 6000 W
	3 AC 400 V	0.4 40	0.1 30 kW
with auxiliary voltag	е		
BH 9097.38/011	3 AC 60 440 V	0.008 0,8	1 600 W
	3 AC 60 440 V	0.08 8	10 6000 W
	3 AC 100 760 V	0.4 40	0.1 52 kW

Auxiliary Circuit

Auxiliary voltage U_H only for BH 9097.38/010,

BH 9097.38/011:

Voltage range: Frequency range of U_{μ} : Input current AC 110 V: AC 230 V: DC 24 V:

AC 110 V (Klemmen A 1 - A 2), AC 230 V (Klemmen A 1 - A 3), DC 24 V 0.8 ... 1.1 U_H 45 ... 400 Hz

approx. 30 mA approx. 15 mA approx.. 50 mA

Technical Data			Standard Type	
Output Contacts: Thermal current I _m : Switching capacity to AC 15 NO contact:	1 changeover conta 1 changeover conta 2 x 5 A 3 A / AC 230 V	act for P2 IEC/EN 60 947-5-1	 BH 9097.38/001 3 AC 400 Article number: 3-phase, without auxiliary Output: Nominal voltage U_N: Width: 	 V 50 / 60 Hz t_a 30 s t_v 10 s 0053944 y supply 1 changeover contact for P1 and 1 changeover contact for P2 3 AC 400 V 45 mm
NC contact: to DC 13:	1 A / AC 230 V 1 A / DC 24 V	IEC/EN 60 947-5-1 IEC/EN 60 947-5-1	Variants	
Electrical life to AC 15 at 3 A, AC 230 V: 947-5-1 Permissible switching frequency: Short circuit strength max. fuse rating: Mechanical life: General Data	2 x 10 ⁵ switching cy 1800 switching cycl 4 A gl 30 x 10 ⁶ switching c	les / h IEC/EN 60 947-5-1	BH 9097: BH 9097.38/001: BH 9097.38/011: BH 9097.38/000: BH 9097.38/010: BH 9097.38/1:	with CCC-approval on request 3-phase without auxiliary supply 3-phase with auxiliary supply 1-phase without auxiliary supply 1-phase with auxiliary supply With galvanically separated current pa For applications with current transform grounded on the secondary side, current range limited to 25 A
Operating mode: Temperature range: Clearance and creepage	continuous - 20 + 55°C		BH 9097.38/801:	same as BH 9097.38/001, but with start up delay $t_a = 0 \dots 10 s$
distances rated impuls voltage /			Ordering example for vari	ants
pollution degree:	4 kV / 2	IEC 60 664-1	BH 9097 .38 / 3 AC 10	00760 V AC 40 A AC 230/110 V
Electrostatic discharge: HF-irradiation: Fast transients: Surge voltages between wires for power supply:	8 kV (air) 10 V / m 2 kV 1 kV	IEC/EN 61 000-4-2 IEC/EN 61 000-4-3 IEC/EN 61 000-4-4		Auxiliary voltage U Max. nom. current of input circuit Nominal voltage U of input circuit
between wire and ground: HF-wire guided: Interference suppression: Degree of protection	2 kV 10 V Limit value class B	IEC/EN 61 000-4-5 IEC/EN 61 000-4-6 EN 55 011		Variant, if required Contacts Type
Housing:	IP 40	IEC/EN 60 529	Characteristics	
Terminals: Housing:	IP 20 Thermoplastic with according to UL sul		i (A)	
Vibration resistance:	Amplitude 0,35 mm		I _N	
Climate resistance: Terminal designation: Wire connection Load terminals:	20 / 055 / 04 EN 50 005 1 x 10 mm ² solid or	IEC/EN 60 068-1		n f (Hz)
Control terminals:	1 x 6 mm ² stranded 1 x 4 mm ² solid or 2 x 1.5 mm ² strande or			v ¹⁷⁹⁵³ relation to input frequency
Wire fixing:	1 x 2,5 mm ² strande DIN 46 228-1/-2/-3/ Box terminals with s protection and Plus screws M3.5	′-4 self-lifting wire	I (A) 6- 5-	
Mounting: Weight:	DIN rail 430 g	IEC/EN 60 715		
Dimensions			2-	
Width x height x depth:	45 x 84 x 121 mm			
CCC-Data			-20 0 +20 +40 +	-55
			continuous current limit curve	

Switching capacity to AC 15: to DC 13:

nfo 3 A / AC 230 V 1 A / DC 24 V

Technical data that is not stated in the CCC-Data, can be found in the technical data section.

IEC/EN 60 947-5-1 IEC/EN 60 947-5-1

Settings

2 rotational switches for P₁: 2 rotational switches for P₂: Potentiometer t_{v_1} : Potentiometer t_{v_2} : Potentiometer t_a : Test/Reset-Taste:

Reset function when manual reset is selected Dip-switches: x10 | x1 selection of upper / lower load range AIR selection of closed or open circuit operation for output relays $P_{2 max.}$ | $P_{2 max}$ P_{1 max}, I P_{1 min} 2 MAX switching values (Overload with Pre-warning) or MAX and MIN switching value (Overload / Underload monitoring) S1 ON | OFF: manual / automatic reset for P1 S2 ON | OFF: manual / automatic reset for P2

Value P₁ (2 decades)

Value P₂ (2 decades)


time delay for value P1

time delay for value P2

start-up delay after connection voltage

Test function as setting assistance


Set-up Procedure and Setting Instructions

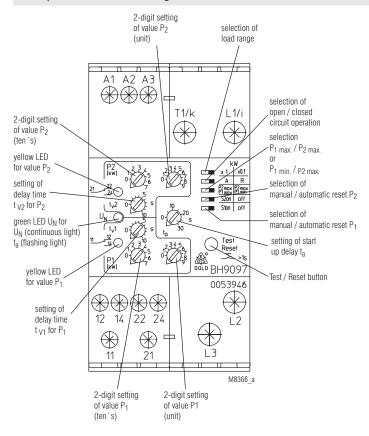

Connection

The device has to be connected according to the connection diagrams. The motor is connected to terminals L/i and T/k or L1/i and T1/k. The flow direction of the current has to be observed. On reverse power the unit gives a fault signal. The max continuous motor current is 40 A limited by the terminals. With higher currents a current transformer with 2,5 VA has to be used.

Adjustemt example: response value: 2,5 kW



The adjustment of the unit can be made without additional measuring equipment and calculations. Please make sure that the load values are in the permitted operating range of the unit. Based on the max permitted values the BH 9097 can be used for 48 kW 3-phase motors at 3 AC 690 V and 5.8 kW single phase motors at AC 230 V.

There are three methods to set up the unit:

Method 1:

If the absolute values of the actual required tripping points P_1 and P_2 are known, they can be set directly on the unit (2-digit setting of P_1 and P_2).


Method 2:


This method is recommended when it is possible to simulate the different load situations during set-up. In this case nothing has to be calculated. Turn the delay time for P_1 and P_2 to min. The motor runs in underload while the Pot 1 is turned until the output relay switches. The same has to be done for overload. Now the unit is set accurately. Now adjust the operate delay and the start-up delay to the required values.


Pressing the test / reset button during setup disables the switching of the output relays. The LEDs of P, and P, flash.


Method 3:


This method is the most simple one but not the most accurate. The operate delay is set to min. The motor is switched on and runs on nominal load. With both potentiometers the set points are searched by slowly turning the max. Pot from high to low value and the min. Pot from low to high value until the corresponding output relays switch. After that turn the Pot P₂ to the right (e.g. + 10 %) side and the Pot P₁ to the left (e.g. - 10 %) until the output relays reset. The unit is now set and responds if the load differs from the nominal value. Finally set the operate delay and start-up delay to the required values. The DIP switch should be set to P_{1 min} / P_{2 max}.



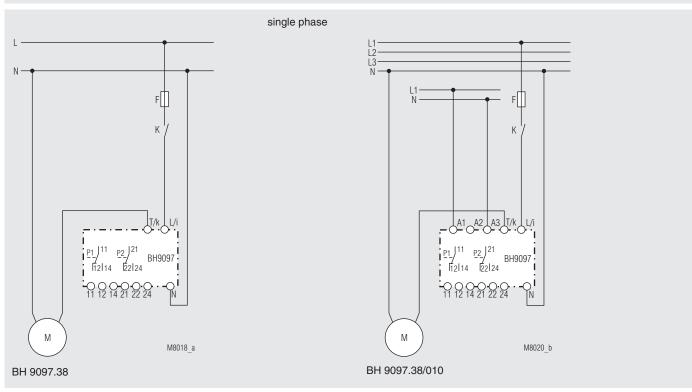

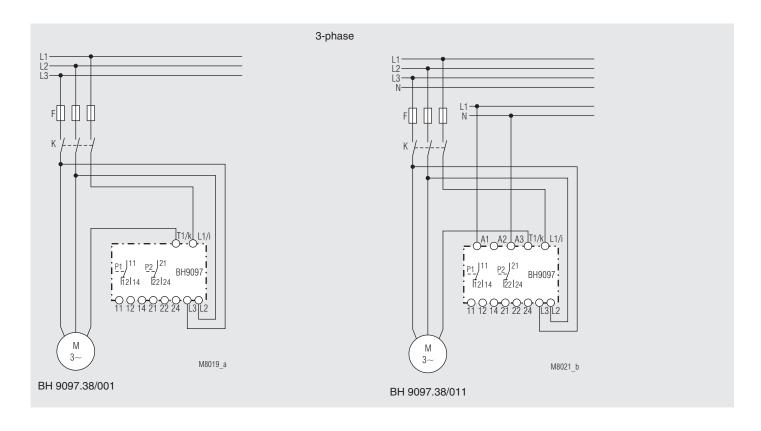



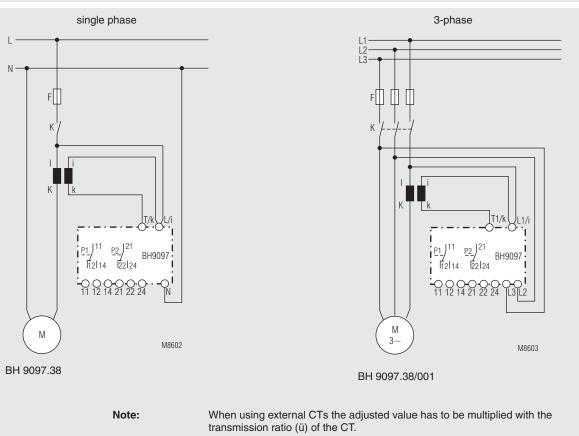

Example: Switching value = Setting value (P1/P2) x ü