


## MINITIMER Timer, Release Delay MK 9962N



- According to IEC/EN 61 812-1
- 8 time ranges from 0.05 s to 300 h selectable via rotational switch
- With auxiliary supply
- Voltage range AC/DC 12 ... 240 V for auxiliary supply and control input
- Adjustment aid for quick setting of long time values
- With input for interruption of timing
- LED indicators for operation, contact position and time delay
- 2 changeover contacts
- With remote potentiometer facility as option
- Wire connection: also 2 x 1.5 mm<sup>2</sup> stranded ferruled, or 2 x 2.5 mm<sup>2</sup> solid DIN 46 228-1/-2/-3/-4
- As option with pluggable terminal blocks for easy exchange of devices
  - with screw terminals
  - or with cage clamp terminals
- 22.5 mm width

### Function Diagram

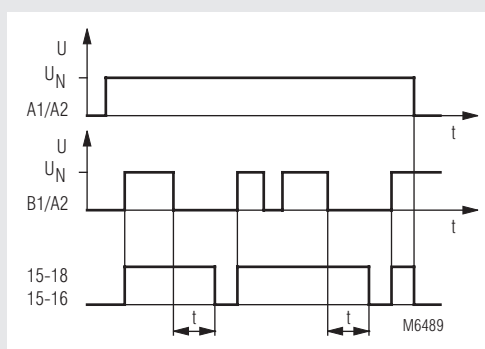

### Approvals and Markings




\* see variants

### Application

Time-dependent controllers

### Circuit Diagrams

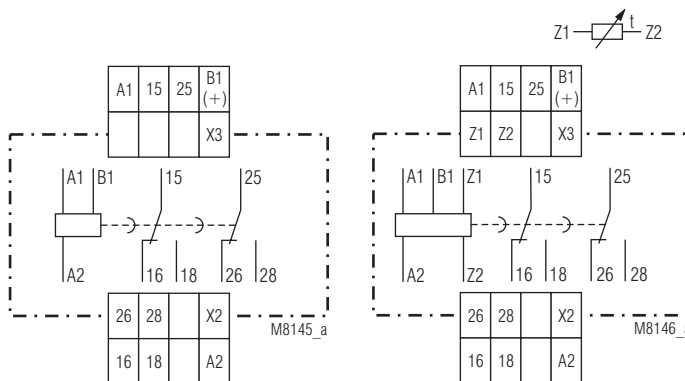

MK 9962N.82

MK 9962N.82/300

### Indicators

- green LED: on when auxiliary voltage connected
- yellow LED "R/t": shows status of output relay and time delay:
- LED off: output relay not active; no time delay
  - LED continuously on: output relay active; no time delay ( $\hat{=}$  B1 input active)
  - LED flashing (long on, short off): output relay active; time delay

### Notes

#### Adjustment assistance

The flashing period of the yellow LED is 1 s  $\pm$  4% and can be used to adjust the time. Especially on the lower end of scale and for long times it is suitable as the multiplication factors between the different time ranges are exact without tolerance.

Example:

The required time is 40 min. It has to be adjusted within the range 3 ... 300 min. The time check takes too long as several timing cycles would be necessary for a precise value.

For faster adjustment the setting is made to 0.03 ... 3 min. On this range the potentiometer should be set to 0.4 min (= 24 sec). With the right potentiometer setting the LED must show 24 flashing cycles. After that the time range is switched over to 3 ... 300 min and the setting is complete.

## Notes

### Remote potentiometer

With the variant MK 9962N.82/300 the time setting can also be made via remote potentiometer of 10 kOhms. It is connected to the terminals Z1-Z2. The corresponding potentiometer on the relay has to be set to min. If no remote potentiometer is required the terminals Z1-Z2 have to be linked. The wires to the remote potentiometers should be installed separately from the lines with mains voltage. If this is not possible, a screened cable is recommended where the shield is connected to Z2. To terminals Z1 and Z2 no external voltage must be connected, as the unit might be damaged.


### Control input B1

The unit needs a continuously connected auxiliary supply on A1-A2. The timing is controlled via input B1. The control unit B1 (+ with DC) has to be supplied with voltage against A2. The control signal could be the same as the auxiliary/control voltage of A1 or any other voltage between 12 and 240 V AC or DC. Operating a parallel load (e.g. a contactor) between B1 and A2 is also allowed.

### Time interruption and time addition with X2 - X3

The time delay can be interrupted during timing by bridging the terminals X2 - X3. By opening the bridge the time continues (time addition). While X2 and X3 are bridged the control input is disabled and the yellow LED remains in the state it had at stop. No external voltage must be connected to X2 and X3 as the unit may be damaged.

## Setting

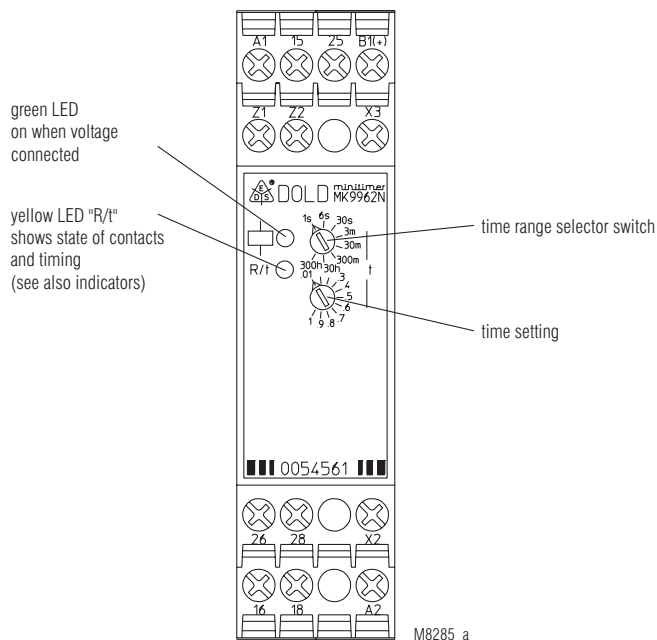

## Technical Data

### Time circuit

#### Time ranges:

8 time ranges settable via rotational switch:

0.05 ... 1 s	0.3 ... 30 min
0.06 ... 6 s	3 ... 300 min
0.3 ... 30 s	0.3 ... 30 h
0.03 ... 3 min	3 ... 300 h

continuous, 1:100 on relative scale

#### Time setting:

#### Minimum on time (B1):

AC 50 Hz:

approx. 15 ms

DC:

approx. 5 ms

#### Repeat accuracy:

± 0.5 % of selected end of scale value + 20 ms

#### Voltage and

#### temperature influence:

≤ 1 % with the complete operating range

## Input

#### Auxiliary voltage $U_H$ :

AC/DC 12 ... 240 V

#### Voltage range:

0.8 ... 1.1  $U_N$

#### Frequency range (AC):

45 ... 400 Hz

#### Nominal consumption

at AC 12 V:

approx. 1.5 VA

at AC 24 V:

approx. 2 VA

at AC 240 V:

approx. 3 VA

at DC 12 V:

approx. 1 W

at DC 24 V:

approx. 1 W

at DC 240 V:

approx. 1 W

#### Release voltage (A1/A2)

AC 50 Hz:

approx. 7.5 V

DC:

approx. 7 V

#### Control voltage (B1/A2):

AC/DC 12 ... 240 V

#### Voltage range (B1/A2):

0.8 ... 1.1  $U_N$

#### Control current (B1):

approx. 1 mA, over complete voltage range

#### Release voltage (B1/A2)

AC 50 Hz:

approx. 3.5 V

DC:

approx. 3 V

## Output

### Contacts

MK 9962N.82:

2 changeover contacts

#### Thermal current $I_{th}$ :

2 x 4 A

#### Switching capacity

to AC 15

NO contact:

3 A / AC 230 V

IEC/EN 60 947-5-1

NC contact:

1 A / AC 230 V

IEC/EN 60 947-5-1

to DC 13:

1 A / DC 24 V

IEC/EN 60 947-5-1

#### Electrical life

to AC 15 at 1 A, AC 230 V:

1.5 x 10<sup>5</sup> switching cycles

#### Permissible switching

frequency:

6 000 switching cycles / h

#### Short circuit strength

max. fuse rating:

4 A gL

IEC/EN 60 947-5-1

#### Mechanical life:

≥ 30 x 10<sup>6</sup> switching cycles

## Technical Data

### General Data

<b>Operating mode:</b>	Continuous operation	
<b>Temperature range:</b>	- 20 ... + 60°C	
<b>Clearance and creepage distances</b>		
rated impulse voltage / pollution degree:	4 kV / 2	IEC 60 664-1
<b>EMC</b>		
Electrostatic discharge:	8 kV (air)	IEC/EN 61 000-4-2
Fast transients:	2 kV	IEC/EN 61 000-4-4
Surge voltages between wires for power supply:	1 kV	IEC/EN 61 000-4-5
HF-wire guided :	10 V	IEC/EN 61 000-4-6
<b>Degree of protection</b>		
Housing:	IP 40	IEC/EN 60 529
Terminals:	IP 20	IEC/EN 60 529
<b>Housing:</b>	Thermoplastic with V0 behaviour according to UL subject 94	
<b>Vibration resistance:</b>	Amplitude 0.35 mm, frequency 10 ... 55 Hz, IEC/EN 60 068-2-6 20 / 060 / 04 IEC/EN 60 068-1	
<b>Climate resistance:</b>	EN 50 005	
<b>Terminal designation:</b>	EN 50 005	
<b>Wire connection</b>	DIN 46 228-1/-2/-3/-4	
<b>Screw terminals (integrated):</b>	1 x 4 mm <sup>2</sup> solid or 1 x 2.5 mm <sup>2</sup> stranded ferruled or 2 x 1.5 mm <sup>2</sup> stranded ferruled or 2 x 2.5 mm <sup>2</sup> solid	
Insulation of wires or sleeve length:	8 mm	
<b>Plug in with screw terminals</b>		
max. cross section for connection:	1 x 2.5 mm <sup>2</sup> solid or 1 x 2.5 mm <sup>2</sup> stranded ferruled	
Insulation of wires or sleeve length:	8 mm	
<b>Plug in with cage clamp terminals</b>		
max. cross section for connection:	1 x 4 mm <sup>2</sup> solid or 1 x 2.5 mm <sup>2</sup> stranded ferruled	
min. cross section for connection:	0.5 mm <sup>2</sup>	
Insulation of wires or sleeve length:	12 ±0.5 mm	
<b>Wire fixing:</b>	Plus-minus terminal screws M 3.5 box terminals with wire protection or cage clamp terminals	
<b>Mounting:</b>	DIN rail	IEC/EN 60 715
<b>Weight:</b>	150 g	

### Dimensions

#### Width x height x depth

MK 9962N:	22.5 x 90 x 97 mm
MK 9962N PC:	22.5 x 111 x 97 mm
MK 9962N PS:	22.5 x 104 x 97 mm

## UL-Data

### Switching capacity:

Ambient temperature 60°C:	Pilot duty B300 5A 250Vac G.P.
---------------------------	-----------------------------------

### Wire connection:

Screw terminals fixed:	60°C / 75°C copper conductors only AWG 20 - 12 Sol/Str Torque 0.8 Nm
Plug in screw:	AWG 20 - 14 Sol Torque 0.8 Nm AWG 20 - 16 Str Torque 0.8 Nm
Plug in cage clamp:	AWG 20 - 12 Sol/Str



Technical data that is not stated in the UL-Data, can be found in the technical data section.


## Standard Type

MK 9962N.82/61	AC/DC 12 ... 240 V	0.05 ... 300 h
Article number:	0054105	
• Output:	2 changeover contacts	
• Auxiliary voltage U <sub>H</sub> :	AC/DC 12 ... 240 V	
• Time ranges:	0.05 ... 300 h	
• Width:	22.5 mm	


## Variants

MK 9962N.82/300/61:	Connection facility for a remote potentiometer 10 kΩ to adjust the time
---------------------	---


## Ordering example for variants

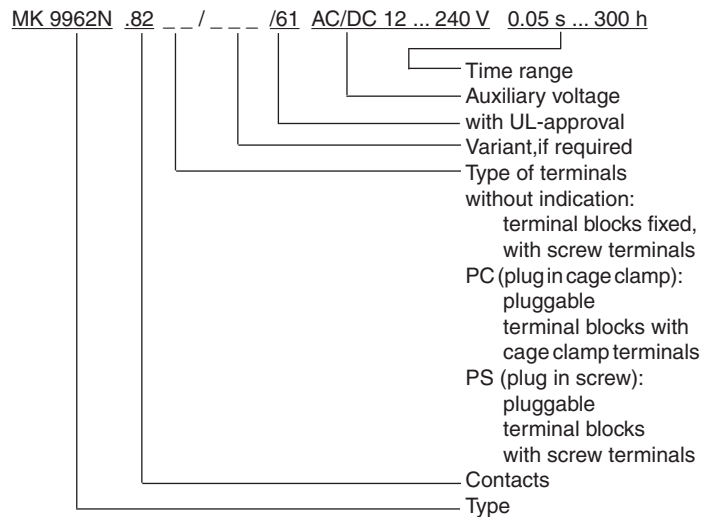

## Options with Pluggable Terminal Blocks



Screw terminal (PS/plugin screw)




Cage clamp (PC/plugin cage clamp)

## Notes

Removing the terminal blocks with cage clamp terminals

1. The unit has to be disconnected.
2. Insert a screwdriver in the side recess of the front plate.
3. Turn the screwdriver to the right and left.
4. Please note that the terminal blocks have to be mounted on the belonging plug in terminations.

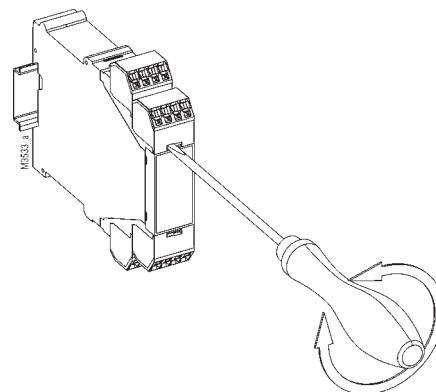


## Accessories

AD 3: External potentiometer 10 kΩ  
Article number: 0028962



The external potentiometer is used for remote setting of the time delay. The internal potentiometer of the timer must be set to min. time delay.

Degree of protection front side:


IP 60

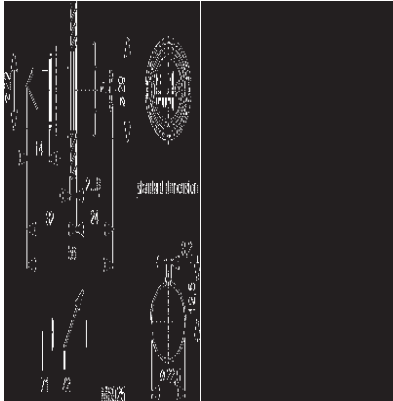

## Connection Examples

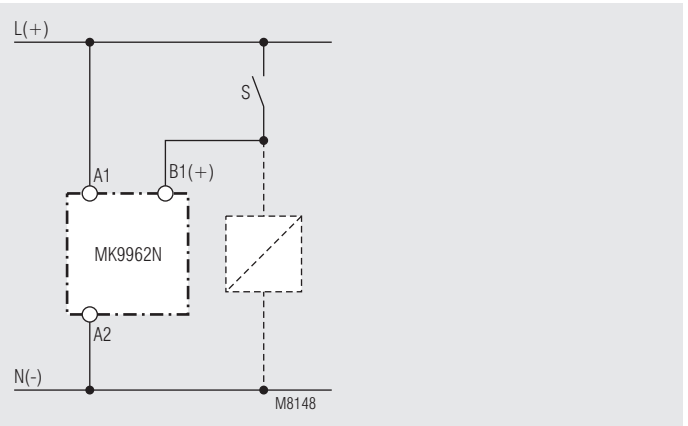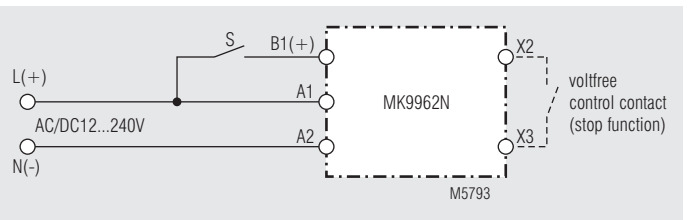

Control with parallel connected load

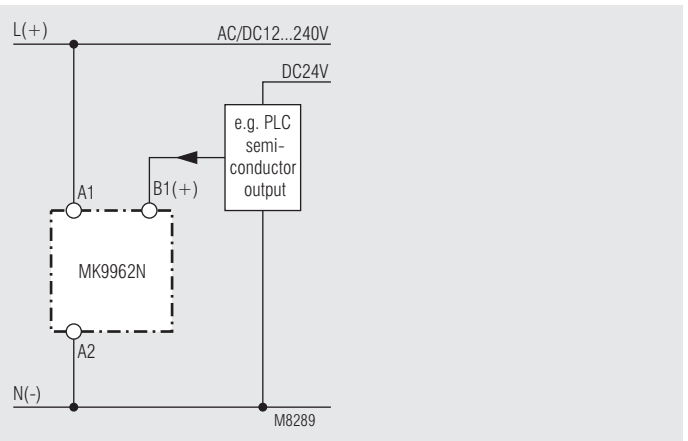

Connection with 2 different control voltages